


WATER HOOK-UP REQUIREMENTS

Each property hook-up must be inspected by at least two board members before covering.

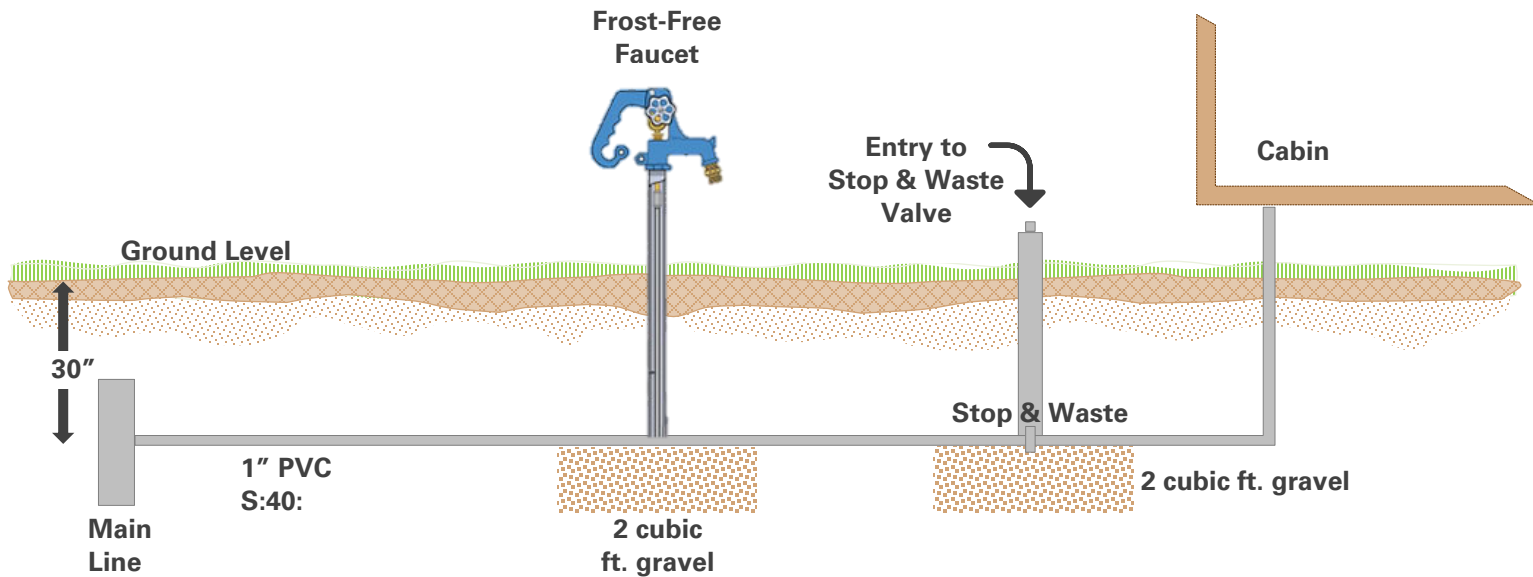

Use only 1" Schedule 40 PVC from main line to cabin with stop and waste valve near cabin.

Frost-Free faucets are needed for winter use.

See diagram for proper installation.

Please contact Scott Unglaub, Operations & Maintenance Officer, with questions

(928) 477-2440